




## ***2022 Drinking Water Quality Report West Slope Water District***

### **Table of Contents**

• Introduction and Message from the General Manager	Page 2
• West Slope Water District History & Source of Water	Page 2
• Portland's Bull Run Water Treatment Plant	Page 5
• Monitoring Results for Cryptosporidium at Bull Run	Page 7
• Contaminants Detected in 2021	Page 7
• Definitions and Additional Information	Page 8
• Portland's Corrosion Control Treatment	Page 11
• Monitoring for Lead and Copper	Page 11
• What EPA Says Can Be Found in Drinking Water	Page 15
• Frequently Asked Questions	Page 15



## **Introduction**

We strive to make the District's Water Quality Report both informative and comfortable to read. We believe you should know important information about your drinking water as well as your water district who delivers it to your home. We hope you spend a few minutes looking at this report. The report is for you, our customers, so we welcome suggestions on how to improve the report for next year. Information we would like you learn about include:

- The water quality tests conducted in 2021
- The source of your drinking water
- Projects the District is looking ahead to accomplish
- How you can reach District staff if you have more questions

The US Environmental Protection Agency (USEPA) requires all water systems in the US including this District to compile this report and make it available to the public for review. We at West Slope Water District think it is a good idea to inform our customers about their water whether it is required or not.

## **Message from the General Manager**

### ***The Three C's of West Slope Water District***

*Recently, Past President of the American Water Works Association Dr. Chi Ho Sham shared his philosophy to successfully empower individuals and ultimately organizations to greatness. It boils down to adopting three simple "Cs" as principles that we can use for ourselves and when working with others:*

- ***Creative***
- ***Collaborative***
- ***Celebratory***

***Creative.*** *In this day and age, simply operating "the way we have always operated" is not sufficient or even effective. The world is changing rapidly, and to adjust to the changing horizon around us, we need to be Creative in how we communicate with District customers, how we manage the District's finances, how we maintain the 48 miles of water mains in the distribution system, and how we plan for a viable and sustainable future for the West Slope Water District. That also means we support and encourage a culture of Creativity within District staff and Board of Commissioners to think "outside of the box" ... to ask "does what we do bring added value to our customers?" ... **Create***

***Collaborative:*** *Decades ago, water utilities largely operated as islands unto themselves strictly working on projects without the aid or assistance of others in the water industry. Today, we know that old*



*philosophy is not in the best interest of a utility's customers. Partnerships, collaborative projects, and shared worker / mutual aid agreements are common today to leverage the best resources and assets among utilities to continue to serve the public well. West Slope Water District is a charter member of the Regional Water Providers Consortium (RWPC), a collaborative organization of the Metropolitan area water providers to create a regional approach to water conservation, emergency preparedness and response, inter-agency communication, and regional water supply, demand, and transmission plans. The RWPC website has a wealth of information for water consumers from how to build a 14-day emergency survival kit for your family to how to maintain your irrigation system for optimal performance ... go to [www.regionalh2o.org](http://www.regionalh2o.org) during its 25<sup>th</sup> anniversary!*


**Collaborate.**

**Celebratory:** *Taking time to recognize the good work that is accomplished is extremely important for the health & well-being of individuals and the organization. In September 2021, the District's long-time Operations Manager Bart Johnson retired after managing very well the operation and condition of the District's distribution system for over 30 years. After working for the District for just over 7 years, Lucy Dawes, the District's Finance & Customer Service Manager, retired at the end of June 2022. Ms. Dawes' numerous contributions to the District can be summarized by saying she turned the District's reactive approach to financial health and stability into a proactive strategic approach that will carry the District soundly into the future. We celebrate those staff contributions and many, many more. This year, the District turns 100 years old, and the staff and the Board of Commissioners of West Slope would like you to **celebrate as a community with us Saturday, September 10 in Raleigh Park**. There will be more details throughout the summer, but come and meet staff, District Commissioners, and others and share your memories, photos, and thoughts about the District through the decades. **Celebrate.***

*Dr. Sham's "Three Cs Philosophy" are more important today than ever before especially following the pandemic as we find ourselves in the midst of turmoil and unrest still today. Thank you for your continued support of your Water District!*

*Best wishes,*

*Michael W. Grimm, P.E.*  
*General Manager, West Slope Water District*



## **West Slope Water District - Established 1922**

The West Slope Water District maintains just over 3300 metered customer accounts serving nearly 10,500 people. The District boundaries are roughly US Hwy 26 on the north, OR Hwy 217 on the west, SW Beaverton-Hillsdale Hwy on the south, and SW Scholls Ferry Road on the east. The District has no water source of its own but instead relies on a wholesale water purchase contract with the Portland Water Bureau for the District's water supply. Portland's water enters the West Slope Water District through the District's two concrete Sylvan Hill reservoirs. The District maintains 48 miles of water mains over a 4-square mile area with three main pressure zones. The water mains range in diameter from 2 inches to 18 inches.


## **West Slope Water District's Drinking Water Sources**

**The City of Portland's Bull Run Watershed**, is a unique, protected (closed to public access) surface water supply located within the Mount Hood National Forest roughly 26 miles from Portland. The watershed is carefully managed to sustain and supply clean drinking water to a quarter of Oregon's population including West Slope. The Bull Run Watershed is a sub-basin watershed in the Sandy River basin that is separate from Mt. Hood and the Hoodland communities found along US Hwy 26. No recreational, residential or commercial uses occur within the watershed. The Portland Water Bureau carefully monitors water quality and quantity in the watershed. The Oregon Health Authority Drinking Water Program regularly inspects the watershed and the related treatment and distribution facilities.

The Portland Water Bureau and the U.S. Forest Service carefully manage the watershed to sustain and supply clean drinking water. On average, the Bull Run watershed receives over 135 inches of precipitation (rain and snow) annually, that flows into the Bull Run River and then into two reservoirs that store nearly 10 billion gallons of drinking water.

Source water assessments are completed to identify contaminants of concern for drinking water. For the Bull Run Watershed, the contaminants of concern are naturally occurring microbes such as *Giardia*, *Cryptosporidium*, fecal coliform bacteria and total coliform bacteria. These organisms are found in virtually all freshwater ecosystems and may be present in the Bull Run Watershed at very low levels. The Portland Water Bureau currently treats the water for these organisms except for *Cryptosporidium*. The Bull Run Watershed is an unfiltered drinking water source. However, the Portland Water Bureau is working to install drinking water filtration by September 2027. For more information about filtration and *Cryptosporidium*, see "**Portland's Water Filtration Treatment Plant Project**" on Page 5.

**Portland's source water assessment is available at [portland.gov/water/resources/source-water-assessment](https://portland.gov/water/resources/source-water-assessment) or by calling 503-823-7525.**



**The Columbia South Shore Well Field**, Portland's groundwater supply, provides drinking water from 25 active wells located in three different aquifers. The well field is between the Portland International Airport and Blue Lake Park. Portland uses the well field for two purposes: to supplement the Bull Run supply in the summer, and to temporarily replace the Bull Run supply during turbidity events, maintenance activities, and emergencies.

The Columbia South Shore Well Field is beneath homes and businesses with a variety of potential contaminant sources. The deep aquifers that are the primary sources of water supply have natural geologic protection from pollutants present at the land surface. Portland, Gresham, and Fairview work together to protect the well field. The cities' Groundwater Protection Programs work with residents and businesses in the well field to ensure that pollutants from this urban area do not impact the groundwater source.

To learn more about groundwater protection and find upcoming groundwater education events, visit [portland.gov/water/groundwater](https://portland.gov/water/groundwater).


## **Portland's Water Filtration Treatment Plant Project**

Since 2017, the Portland Water Bureau's engineering staff and consulting design engineers have been working to design and build a new Bull Run Water Treatment Facility to treat for microbial contaminants like *Cryptosporidium*. In 2020, the project team submitted two years of testing data confirming the best filtration method to build. The Oregon Health Authority (OHA) has approved the City's water filtration plant design. The final water treatment facility design will be completed by the end of 2022, and construction is anticipated to begin in 2023. The desired outcomes of the new Bull Run Water Treatment Facility include:

- Filtration will remove *Cryptosporidium* and other microbial pathogens from the water
- Disinfection will continue to control the spread of microorganisms in the water
- Corrosion control treatment process installed at the treatment facility will continue to lower lead levels at customers' taps
- Even with the treatment facility, the Bull Run Watershed will remain highly protected

For more information about the new treatment facility, visit [portland.gov/BullRunTreatment](https://portland.gov/BullRunTreatment)


## Bull Run Water Treatment

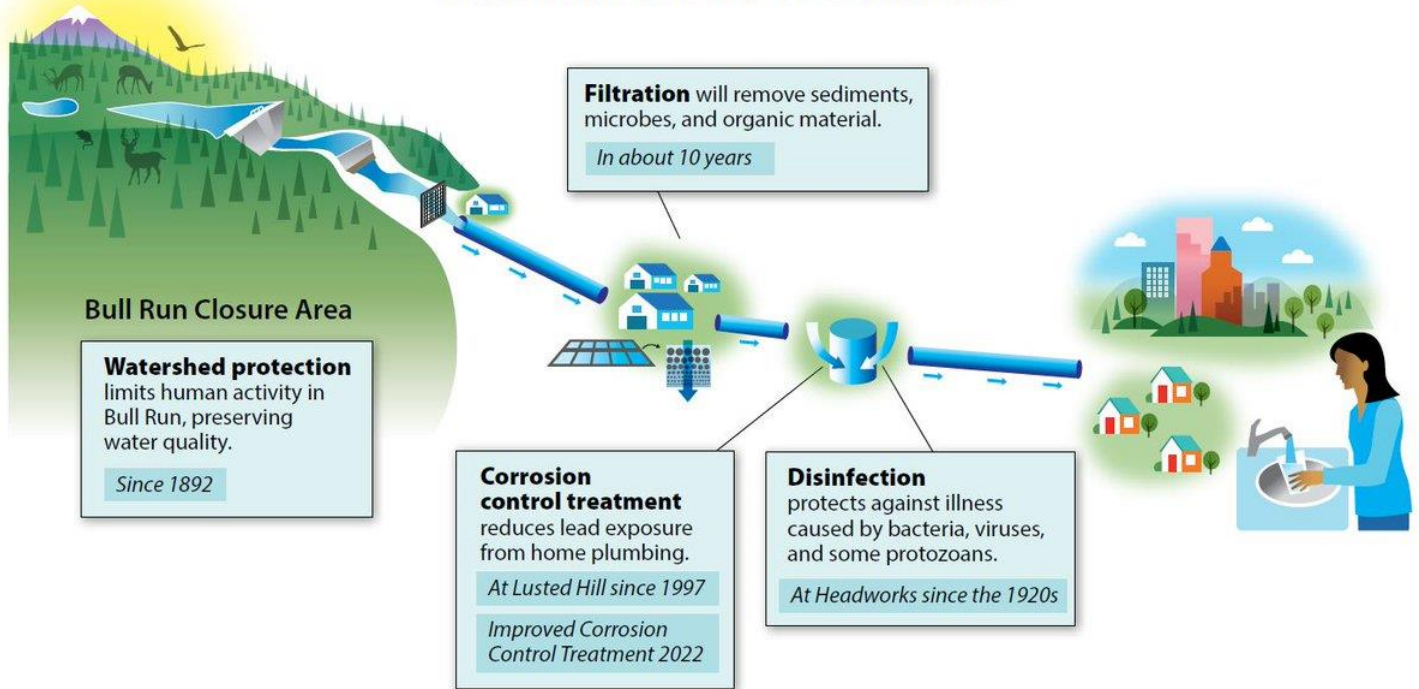

The Portland Water Bureau does not currently treat for *Cryptosporidium*, but the City is required to do so under state and federal drinking water regulations. Portland is working to install filtration treatment by 2027 under a compliance agreement with OHA. Meanwhile, the Portland Water Bureau is implementing interim measures such as watershed protection and additional raw water monitoring for *Cryptosporidium* to protect public health. Consultation with public health officials continues to conclude that the general public does not need to take any additional precautionary measures.

Exposure to *Cryptosporidium* can cause cryptosporidiosis, a serious illness. Symptoms can include diarrhea, vomiting, fever, and stomach pain. People with healthy immune systems recover without medical treatment. According to the Centers for Disease Control and Prevention (CDC), people with severely weakened immune systems are at risk for more serious disease. Symptoms may be more severe and could lead to a serious life-threatening illness. Examples of people with weakened immune systems include those with AIDS, those with inherited diseases that affect the immune system, and cancer and transplant patients who are taking certain immunosuppressive drugs.

The Environmental Protection Agency has estimated that a small percentage of the population could experience gastrointestinal illness from *Cryptosporidium* and advises that customers who are immunocompromised and receive their drinking water from the Bull Run Watershed consult with their health care professional about the safety of drinking the tap water.



## Monitoring for Cryptosporidium

### 2021 Results of *Cryptosporidium* Monitoring at the Raw Water Intake

Number of Samples		Concentration Detected (oocysts/L)	
Total Tested	Positive for <i>Cryptosporidium</i>	Minimum	Maximum
200	33	Not Detected	0.12


More information: [portlandoregon.gov/water/crypto](http://portlandoregon.gov/water/crypto)

## Special Notice for Immuno-Compromised Persons

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly people and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. Environmental Protection Agency (EPA)/ Centers for Disease Control and Prevention (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at **800-426-4791**.

## Contaminants Detected in 2021

Regulated Contaminant	Detected in Your Drinking Water		EPA Standard		Sources of Contaminant
	Minimum	Maximum	MCL or TT	MCLG	
<b>Untreated Source Water – Monitored by the City of Portland</b>					
Turbidity (NTU)	0.18	2.81	5	N/A	Erosion of natural deposits
Fecal Coliform Bacteria (% >20 colonies/100 mL in 6 months)	Not Detected	0%	10%	N/A	Animal wastes
<i>Giardia</i> (#/L)	Not Detected	0.08	TT	N/A	Animal wastes
<b>Treated Drinking Water – Monitored by the City of Portland</b>					
Metals and nutrients at the entry points – Monitored by the City of Portland					
Arsenic (ppb)	<0.50	1.02	10	0	Found in natural deposits
Barium (ppm)	0.00081	0.01030	2	2	Found in natural deposits
Cyanide (ppm)	<0.005	0.014	0.2	0.2	Naturally made by algae and plants



# West Slope Water District 2022 Drinking Water Quality Report

Fluoride (ppm)	<0.025	0.160	4	4	Found in natural deposits	
Lead (ppb)	<0.05	0.15	15	0	Found in natural deposits	
Nitrate – Nitrogen (ppm)	<0.010	0.087	10	10	Found in natural deposits; animal wastes	
<b>Microbial contaminants in the distribution system – Monitored by West Slope Water District</b>						
Total Coliform Bacteria (% positive per month)	0%	0%	N/A	N/A	Found throughout the environment	
<b>Disinfection residual and byproducts in the distribution system – Monitored by West Slope Water District</b>						
Total Chlorine Residual (ppm)	Running annual average	1.30	1.47	4 [MRDL]	4 [MRDLG]	Chlorine used to disinfect water
	Range of single results at all sites	0.9	1.90	N/A	N/A	
Haloacetic Acids (ppb)	Running annual average at any one site	17.9	22.6	60	N/A	Byproduct of drinking water disinfection
	Range of single results at all sites	13.0	34.0	N/A	N/A	
Total Trihalomethanes (ppb)	Running annual average at any one site	28.5	29.1	80	N/A	Byproduct of drinking water disinfection
	Range of single results at all sites	21.1	39.1	N/A	N/A	

Unregulated Contaminants	Detected in Portland’s Treated Water			Sources of Contaminant
	Minimum	Average	Maximum	
Radon (pCi/L)	<50	186	372	Found in natural deposits
Sodium (ppm)	3.0	6.5	15	
Manganese (ppm)	0.0019	0.0152	0.0319	

## Definitions


### MCL: Maximum Contaminant Level

The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

### MCLG: Maximum Contaminant Level Goal

The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.





**MRDL: Maximum Residual Disinfectant Level**

The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**MRDLG: Maximum Residual Disinfectant Level Goal**

The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

**N/A: not applicable**

Some contaminants do not have a health-based level or goal defined by the EPA.

**NTU: Nephelometric Turbidity Unit**

The unit for measuring the turbidity, or cloudiness, of a water sample.

**ppm: parts per million**

Water providers use ppm to describe a small amount of a substance within the water. In time measurement, one part per million is about 32 seconds out of one year.

**ppb: parts per billion**

Water providers use ppb to describe a very small amount of a substance within the water. In time measurement, one part per billion is about 3 seconds out of 100 years.

**pCi/L: picocuries per liter**

Picocurie is a measurement of radioactivity.

**TT: Treatment Technique**

A required process intended to reduce the level of a contaminant in drinking water.


## **About These Contaminants**

**Arsenic, barium, fluoride, and manganese**

These metals are elements found in the earth's crust. They can dissolve into water that is in contact with natural deposits. Analytical results for manganese can be found on Page 7 in a table labeled "Unregulated Contaminants". At the levels found in your drinking water, they are unlikely to lead to negative health effects.

**Fecal coliform bacteria**

As part of The City of Portland's compliance with the filtration avoidance criteria of the Surface Water Treatment Rule, water is tested for fecal coliform bacteria before disinfectant is added. The presence of fecal coliform bacteria in source water indicates that water may be contaminated with animal



wastes. This is measured in percent of samples with more than 20 colonies in 100 milliliters of water during any six-month period. The City of Portland uses chlorine to control these bacteria.

### ***Giardia***

Wildlife in the watershed may be hosts to *Giardia*, a microorganism that can cause gastro-intestinal illness. The treatment technique (TT) is to remove 99.9 percent of *Giardia* cysts. The City of Portland uses chlorine to control *Giardia*.

### **Haloacetic acids and total trihalomethanes**

Disinfection byproducts form when chlorine interacts with naturally-occurring organic material in the water. High levels of disinfection byproducts can cause health problems in people. The City of Portland adds ammonia to form a more stable disinfectant, which helps minimize disinfection byproducts.

### **Nitrate - Nitrogen**

Nitrate, measured as nitrogen, can lead to bacterial and algal growth in the water. At levels that exceed the standard, nitrate can contribute to health problems. At the levels found in your drinking water, nitrate is unlikely to lead to negative health effects.

### **Radon**

Radon is a naturally occurring radioactive gas that cannot be seen, tasted, or smelled. Radon can be detected at very low levels in the Bull Run water supply and at varying levels in Portland's groundwater source supply. Based on the historical levels of radon in groundwater combined with the limited amount of groundwater used, District customers are unlikely to have negative health effects from radon in water. Find more information about radon from the EPA at [epa.gov/radon](https://www.epa.gov/radon).

### **Sodium**


There is currently no drinking water standard for sodium. At the levels found in drinking water, it is unlikely to lead to negative health effects.

### **Total chlorine residual**

Total chlorine residual is a measure of free chlorine and combined chlorine and ammonia in West Slope Water District's distribution system. Chlorine residual is a low level of chlorine remaining in the water and is meant to maintain disinfection through the entire distribution system.

### **Total Coliform bacteria**

Coliform bacteria are naturally present in the environment. Coliform bacteria do not make people sick. They are used as an indicator organism that other potentially harmful bacteria may be present. If more than 5 percent of samples in a month are positive for total coliform bacteria, an investigation must be conducted to identify and correct any possible causes. The City of Portland adds chlorine as a disinfectant to control these bacteria.



### **Turbidity**

Turbidity is the cloudiness of a water sample. In City of Portland's Bull Run water source, increased turbidity usually comes from large storms, which suspend organic material in Bull Run water. Increased turbidity can interfere with disinfection and provide an environment for microorganisms to grow. Since the City of Portland does not yet filter Bull Run water at this time, the treatment technique (TT) is that turbidity cannot exceed 5 NTU more than 2 times in 12 months. When turbidity rises in the Bull Run source, the City of Portland switches to its Columbia South Shore Well Field source.

## **Portland's Improved Corrosion Control Treatment**

### **Corrosion Control Treatment Facility Began Operation April 2022**


Portland began operating the new Improved Corrosion Control Treatment Facility to reduce the levels of lead in drinking water for all Portland retail and wholesale customers like West Slope Water District. The new facility uses two naturally occurring compounds to add corrosion control protection to our drinking water: Sodium carbonate (aka soda ash) and carbon dioxide. The City's treatment goal is to raise the pH of the water from 8.2 – 8.3 to a new 8.5 target and to raise the alkalinity of the water from background levels less than 10 mg/l to 25 mg/l. After detecting elevated levels of lead in higher risk homes in 2013, the City started to plan for improved corrosion control to better protect public health. Elevated lead levels in high risk homes were also detected Fall 2016, Fall 2017, and again in Fall 2021. The new corrosion control treatment facility began operation April 2022.

However, the corrosion control changes in the water will not take place all at once. The City will make incremental treatment changes to the water to allow the water system to adjust to the water quality changes. During the transition stage, the City and its wholesale partners like West Slope Water District will be collecting samples to assess the effectiveness of the corrosion control process changes. Monitoring and analyzing the changes will allow the City to optimize the corrosion control treatment process to reduce in-home lead levels as much as possible.

## **Monitoring for Lead and Copper**

### **Routine testing at homes with higher risk of lead in water**

Twice each year, the West Slope Water District participates with the Portland Water Bureau to monitor for lead and copper in tap water from a sample group of more than 100 homes. These are homes where the plumbing is known to contain lead solder and represent a worst-case scenario for lead in water. Called the Joint Monitoring Plan (JMP), samples are collected after the water has been standing in the household plumbing for more than 6 hours. A Lead and Copper Rule exceedance for lead occurs when the 90<sup>th</sup> percentile of samples collected exceeds the lead action level of 15 parts per billion. In the Fall 2021 round of testing 90<sup>th</sup> percentile of all samples collected in the JMP was 21



# West Slope Water District 2022 Drinking Water Quality Report

which exceeded the lead action level of 15 parts per billion meaning Portland and the other water utilities participating in the JMP including West Slope Water District were not in compliance with the Lead and Copper Rule. None of the homes sampled in the West Slope Water District exceeded the lead action level, however.

The Portland Water Bureau offers free lead-in-water tests to anyone in the JMP service area including West Slope Water District customers through the **LeadLine (See Page 13 for more information on how to get your own free lead test kit)**. Lead testing kits from the **LeadLine** allow customers to test the lead content in drinking water in their home at no additional cost to West Slope customers.

### Lead and Copper Testing Results from High-Risk Residential Water Taps in West Slope WD

Regulated Contaminant	Detected in Residential Water Taps		EPA Standard		Sources of Contaminant
	Highest Level From 2021 Data <sup>1</sup>	Homes Exceeding Action Level <sup>2</sup>	Action Level <sup>2</sup>	MCLG <sup>3</sup>	
Lead (ppb) <sup>3</sup>	4.10	0 out of 2 (0.0%)	15	0	Corrosion of household and commercial building plumbing systems
Copper (ppm) <sup>3</sup>	0.070	0 out of 2 (0%)	1.3	1.3	

### Lead and Copper Testing Results from High-Risk Residential Water Taps in the JMP

Regulated Contaminant	Detected in Residential Water Taps		EPA Standard		Sources of Contaminant
	Spring 2021 Results <sup>1</sup>	Homes Exceeding Action Level <sup>2</sup>	Action Level <sup>2</sup>	MCLG <sup>3</sup>	
Lead (ppb) <sup>3</sup>	11.0	4 out of 113 (3.5%)	15	0	Corrosion of household and commercial building plumbing systems
Copper (ppm) <sup>3</sup>	0.273	0 out of 118 (0%)	1.3	1.3	


### Lead and Copper Testing Results from High-Risk Residential Water Taps in the JMP

Regulated Contaminant	Detected in Residential Water Taps		EPA Standard		Sources of Contaminant
	Fall 2021 Results <sup>1</sup>	Homes Exceeding Action Level <sup>2</sup>	Action Level <sup>2</sup>	MCLG <sup>3</sup>	
Lead (ppb) <sup>3</sup>	21.0	14 out of 104 (13.5%)	15	0	Corrosion of household and commercial building plumbing systems
Copper (ppm) <sup>3</sup>	0.238	0 out of 104 (0%)	1.3	1.3	

<sup>1</sup> 90<sup>th</sup> Percentile: 90 percent of the sample results were less than the values shown.

<sup>2</sup> Action Level definition: The concentration of a contaminant which, if exceeded, triggers treatment or requirements of which a water system must follow.

<sup>3</sup> See Pages 8-11 for definitions.



## **Additional Thoughts About Lead in Drinking Water**

West Slope Water District cares about the health of the families in our community and is committed to help you limit your exposure to lead in drinking water. If present, lead at elevated levels can cause serious health problems, especially for pregnant women and young children. Infants and children who drink water containing lead in excess of the Action Level could experience delays in their physical or mental development. Children could show slight deficits in attention span and learning abilities. Adults who drink this water over many years could develop kidney problems or high blood pressure.

Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The District is responsible for providing high quality drinking water, but the District cannot control the variety of materials used in plumbing components in homes or buildings. Lead is rarely found in the source water that comes from the City of Portland, and there are no known lead service lines in the West Slope water system. In the Metro region, lead enters drinking water from the corrosion (wearing away) of household plumbing materials containing lead. These materials include lead-based solder used to join copper pipe — commonly used in homes built or plumbed between 1970 and 1985 — and brass components and faucets installed before 2014.


When your water has been sitting for several hours, such as overnight or while away at work or school, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your drinking water, you can request a free lead-in-water test from the **LeadLine** at **503-988-4000** or [leadline.org](https://www.leadline.org). Information on lead in drinking water, testing methods and steps you can take to minimize exposure is available from the **Safe Drinking Water Hotline—800-426-4791** or [epa.gov/safewater/lead](https://www.epa.gov/safewater/lead).

***In Portland Metro Region, the most common sources of lead exposure are lead-based paint, household dust, soil, and plumbing materials. Lead is also found in other household objects such as toys, cosmetics, pottery, and antique furniture.***

### **Protecting Public Health**

The District is a participating member of the City of Portland's Lead Hazard Reduction Program and takes a comprehensive approach to reducing exposure to lead. Through this program the City of Portland provides on behalf of the West Slope Water District, the following strategic tasks:

- **Corrosion Control Treatment** This treatment reduces corrosion of lead in plumbing by increasing the pH and the amount of alkalinity in the drinking water.
- **Lead-in-Water Testing** Anyone in the service area can test their water for lead at no additional charge to the customer through the City of Portland's water testing laboratory. The District and the City of Portland target outreach to households most at-risk from lead in water (houses built between 1970 and 1985).



- **Education, Outreach and Testing** Agencies and organizations receive grant funds to help people reduce their exposure to all sources of lead.
- **Home Lead Hazard Reduction** The Portland Housing Bureau's Lead Hazard Control Program, with support from the Portland Water Bureau, removes lead paint hazards in homes.

**Reduce your exposure to all sources of lead.**

**Contact the LeadLine:**


[leadline.org](https://www.leadline.org)

**503-988-4000**

- Free lead-in-water testing
- Free childhood blood lead testing
- Free lead reduction services

**Easy steps to reduce possible exposure to lead from household plumbing**

- **Run your water to flush the lead out.** If no one has used your water in several hours, run the tap for 30 seconds to 2 minutes or until the water becomes colder before using the water for drinking or cooking. Running the tap flushes water that could contain lead.
- **Use cold, fresh water for cooking, drinking, and preparing baby formula.** Lead dissolves more easily into hot water. Do not use water from the hot water tap for cooking, drinking, or to make baby formula.
- **Do not boil water to remove lead.** Boiling water will not reduce lead.
- **Test your child for lead.** Ask your doctor or contact the **LeadLine** to find out how to have your child tested for lead. A blood lead level test is the only way to know if your child is being exposed to lead.
- **Test your water for lead.** Contact the **LeadLine** to find out how to get a FREE lead-in-water test.
- **Consider using a filter.** Check to make sure it reduces lead —not all filters do. To protect your water quality, follow the manufacturer's instructions for maintaining and replacing your filter. To find out more about water filter performance standards: [nsf.org](https://www.nsf.org) or 800-NSF-8010.
- **Clean your faucet aerators every few months.** Faucet aerators can trap particles from household plumbing and the particles may contain lead. Every few months, unscrew and rinse your aerators.
- **Consider replacing old fixtures.** Since 2014, all pipes, fittings and fixtures are required to contain less than 0.25% lead.



## **What the EPA Says Can Be Found in Drinking Water**

Across the United States, the sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

In order to ensure that tap water is safe to drink, the Environmental Protection Agency (EPA) has regulations that limit the amount of certain contaminants in water provided by public water systems and require monitoring for these contaminants. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

Contaminants in drinking water sources may include: **microbial contaminants**, such as viruses, bacteria, and protozoa from wildlife; **inorganic contaminants**, such as naturally-occurring salts and metals; **pesticides and herbicides**, which may come from farming, urban stormwater runoff, or home and business use; **organic chemical contaminants**, such as byproducts from industrial processes or the result of chlorine combining with naturally-occurring organic matter; and **radioactive contaminants**, such as naturally-occurring radon.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline at 800-426-4791 or at [epa.gov/safewater](https://www.epa.gov/safewater).

## **Frequently Asked Questions About Water Quality**

### **What test results will I find in this report?**


The Portland Water Bureau and West Slope Water District monitor drinking water for over 200 regulated and unregulated contaminants. This report lists all of the regulated contaminants detected in drinking water in 2021. **If a known, health-related contaminant is not listed in this report, the Portland Water Bureau and West Slope Water District did not detect it in drinking water.**

### **How is West Slope's drinking water treated?**

Currently, the City of Portland operates a three-step drinking water treatment process. **1) Chlorine** disinfects against organisms that could otherwise make people sick. **2) Ammonia** stabilizes chlorine to form a longer-lasting disinfectant. **3) Sodium hydroxide** reduces corrosion of metals like lead.

### **Is West Slope's water safe from viruses such as COVID-19?**

Yes, your water is safe from viruses and safe to drink. Your water is disinfected to control microorganisms such as viruses and bacteria.



**Is my water filtered?**

No. Neither of the City of Portland's source waters are currently filtered before it is purchased by the District. In response to a series of low-level detections of *Cryptosporidium* since 2017, the City of Portland is designing and planning construction of a filtration plant to treat for *Cryptosporidium*. Bull Run water will be filtered by 2027.

**Does my water have any added fluoride?**

No. Fluoride naturally occurs in the City of Portland's source water at very low levels. You may want to ask your dentist or doctor about supplemental fluoride for preventing tooth decay. This is especially important for young children.

**Is my water soft or hard?**

Bull Run water—Portland's main water supply—is very soft. It typically has a total hardness of 3–8 parts per million (ppm), or ¼ to ½ a grain of hardness per gallon.

Portland's groundwater supply is moderately hard: about 80 ppm, or about 5 grains per gallon.

**What is the pH of my water?**

The pH of Portland's drinking water typically ranges between 7.5 and 8.5.

**How can I get my water tested for lead?**

For free lead-in-water testing, contact the **LeadLine** at [leadline.org](https://www.leadline.org) or **503-988-4000**. For other testing, you can pay a private laboratory to test your tap water. Not all labs are accredited to test for all contaminants. For information about accredited labs, contact the Oregon Health Authority at [ORELAP.Info@state.or.us](mailto:ORELAP.Info@state.or.us) or **503-693-4100**.

**What causes temporary discolored water?**

Since the City of Portland's water is not filtered, sediment and organic material from the Bull Run Watershed is present in Portland's water supply and is periodically passed on to the West Slope Water District. This can sometimes be seen in the District when construction, hydrant use, firefighting, or water main breaks stir up the sediment that has settled at the bottom of the water mains. It can also be seen in the fall as a harmless tea-colored tint (usually in the fall). Another source of discolored water are older pipes in buildings. These pipes can add rust to water when no one has used the water for several hours. Find out more at [portlandoregon.gov/water/discoloredwater](https://www.portlandoregon.gov/water/discoloredwater).


**Have water quality or pressure issues or concerns? Contact the Water Quality Line:**

[customer.service@wswd.org](mailto:customer.service@wswd.org)

503-292-2777

[www.wswd.org](https://www.wswd.org)





## West Slope Water District 2022 Drinking Water Quality Report

Page | 17

**If you turned on your faucet and the water was discolored, or the flow was less than normal, would you know what to do?**

For all water quality or service questions at your home, please call the West Slope Water District at 503-292-2777. For additional information, you may also obtain a copy of the City of Portland's **Customer Guide to Water Quality and Pressure** for maintenance and troubleshooting tips. You can find it online at: [portlandoregon.gov/water/guide](http://portlandoregon.gov/water/guide) or you can call the Portland Water Bureau at 503-823-7525 to request a paper copy.

**Please visit our website at [WWW.WSWD.ORG](http://WWW.WSWD.ORG) for more information about your water and the District.**

**Please call us at [503-292-2777](tel:503-292-2777) to talk with us about your specific issues or if you have a question for us. You can also use that number to alert us to an emergency.**

**We can also be reached at [customer.service@wswd.org](mailto:customer.service@wswd.org) if you have questions or concerns for us.**

**However you reach us, we look forward to hearing from you! Thank you!**